

**ADDRESSABLE MANUAL CALL POINT WITH LINE ISOLATOR**

**FEATURES**

Manual call point with individual addressing technology.  
 Resettable by means of a key and with transparent protection cover.  
 It includes a loop isolator element.

**EN 54-11:2001 / A1:2005 certified.**

**APPLICATION**


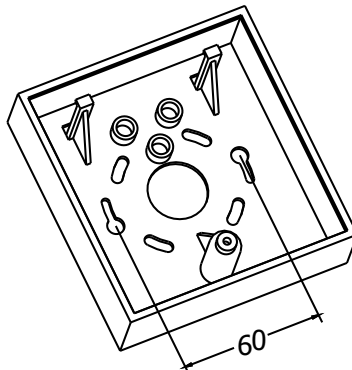
Manual call point for indoor use to set on manually the fire alarm, for M450A Fire Detection System

**PHYSICAL**

Wall mounting casing 110 x 105 x 59 mm

**TECHNICAL SPECIFICATION**

Supply:	15 Vcc to 33 Vcc
Current drain stand by:	35 uA @ 24V
Current drain when triggered:	3 mA @ 24V
Operating temperature:	-10°C to 70°C
Storage temperature:	-20°C to 80°C
Humidity:	95% not condensed
IP ingress protection:	IP21

**WIRING DIAGRAM**

**MOUNTING PLATE**


LGAJ Technological Center, S.A.  
C/ Indústria, 5 - nave A  
Apartado de Correos 18  
E - 08193 Bellaterra (Barcelona)  
T +34 93 597 20 00  
F +34 93 597 20 01  
www.lgaj.com



0370

SISTEMAS DE SEGURIDAD MIRA S.L.  
C/ Indústria, 5 - nave A  
08800 Vilanova i la Geltrú - Barcelona  
www.ssmira.es

11

0370-CPD-1255

EN 54-11:2001, EN 54-11:2001/A1:2005  
PULSADOR MANUAL DE ALARMA  
MODELOS: M101A

DATOS TÉCNICOS: VEASE EL MANUAL (en caso de requerir  
más información contacte con el fabricante)

LGAJ TECHNOLOGICAL CENTER, S.A. C.I.F. A-63207492



Notified body N°0370



N.º

0370-CPD-1255

CERTIFICATE

### EC-CERTIFICATE OF CONFORMITY

In compliance with the Directive 89/106/EEC of the Council of European Communities of 21 December 1988 on the approximation of laws, regulations and administrative provisions of the Member States relating to the construction products (Construction Products Directive - C.P.D.), amended by the Directive 93/68/EEC of the Council of European Communities of 22 July 1993, it has been stated that the construction product:

**FIRE DETECTION AND FIRE ALARM SYSTEMS, PART 11. MANUAL CALL POINTS**  
**MODEL: M101A ANALOGUE CALL POINT**

Placed on the market by:

**SISTEMAS DE SEGURIDAD MIRA, S.L.**  
**C/INDUSTRIA, 5 NAVE A**  
**08800 VILANOVA I LA GELTRÚ (BARCELONA)**

And produced in the factory:

**1293291385**

Is submitted by the manufacturer to a factory production control and to the further testing of samples taken at the factory in accordance with a prescribed test plan and that the notified body -LGAJ TECHNOLOGICAL CENTER S.A. - has performed the initial type-testing for the relevant characteristics of the product; the initial inspection of the factory and of the factory production control and performs the continuous surveillance, assessment of the factory production control and the subsequent testing of samples taken at the factory, on the market or at the construction site.

This certificate attests that all provisions concerning the attestation of conformity and the performance described in the Annex ZA of the standard were applied and that the product fulfils all the prescribed requirements.

**EN 54-11:2001, EN 54-11:2001/A1:2005**

This certificate was first issued on 27<sup>th</sup> January 2012 and remains valid as long as the conditions laid down in the harmonised technical specification in reference or the manufacturing conditions in the factory or the PCP itself are not modified significantly; it is confirmed on 1<sup>st</sup> October 2012.

Bellaterra, 11<sup>th</sup> October 2012



Jordi Bonifau Roldans  
General Manager

Xavier Ruiz Pons  
Product Conformity B.U., Manager



This document is not valid without its technical annex, whose number coincides with the number of certificate